

FEATURES & BENEFITS

TEMPERED WATER

Heated, insulated blanket provides ANSI compliant tempered potable water in operating temperatures down to -30° C. Unit will stay tempered in non-extreme outdoor conditions (below 38° C). Installed over the Haws model 7603.

OPTIONS


For more information, visit www.haws.ch or call + 41(0)34 420 60 00.




SPECIFICATIONS


Model EU 7603BL240 NEMA 4, heated, insulated blanket to provide ANSI compliant tempered potable water in operating temperatures down to -30° C. The self-contained blanket easily installs on to existing model 7603. Eyewash and heating blanket offered as a package or individually. 240VAC, 50/60 Hz, 0.64A electrical requirement. Power cord not provided – power connection must be made according to code using Class I Division 2 compliant equipment. Haz Loc options available. CSA certified for NEMA/Type 4 in ordinary locations, and to ANSI/ISEA Z358.1

APPLICATIONS

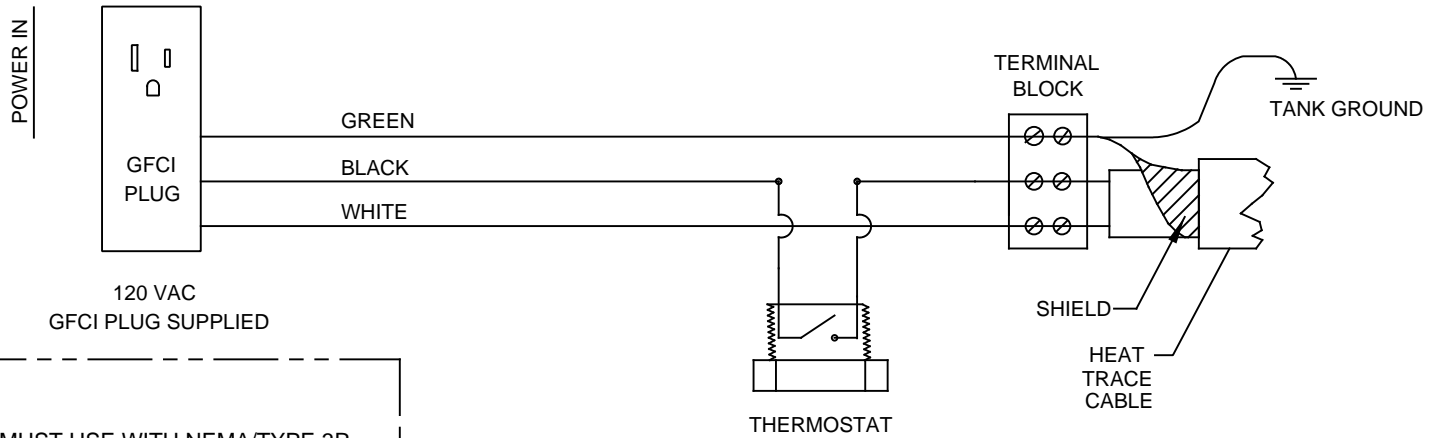

 FOR 7603BL: MUST USE WITH NEMA/TYPE 3R CERTIFIED COVERED OUTLET (NOT SUPPLIED).


**MODEL 7603BL
ELECTRICAL DETAIL**

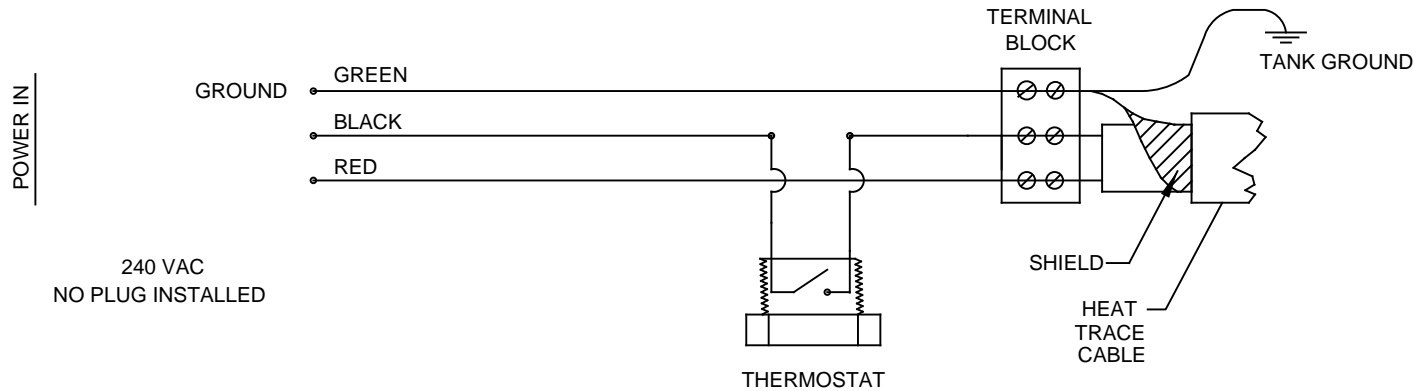

**MODEL 7603BL240
ELECTRICAL DETAIL**

FOR MODEL 7603BL240:

1. CORD SET SHALL BE LISTED TO UL 817 AND CSA-C22.2 NO. 21 AND PROVIDED WITH 3 WIRE GROUNDING TYPE ATTACHMENT PLUG RATED 240 V, MIN. 15 A.
2. THE FLEXIBLE CORD TYPE SHALL BE TYPE S, SE, SJ, SJE, SJO, SJO, SJTO, SJTOO, SO, SOO, ST, STO, OR STOO AND HAVE A TYPE LETTER SUFFIX OF "W," "W-A" OR "OUTDOOR."
3. THE CORD SET SHALL BE MIN. 6 FT IN LENGTH AND MIN 18 AWG SIZE FOR FLEXIBLE POWER SUPPLY CORD.
4. LISTED STRAIN RELIEF BUSHING SUITABLE FOR CORD SET SIZE AND OUTDOOR USE SHALL BE USED.
5. ALL POWER CONNECTIONS MUST BE MADE ACCORDING TO NEC/CEC CODE USING FLEXIBLE CONDUIT OR CABLE RATED FOR NEMA/TYPE 4 – NO RIGID CONNECTION PERMITTED. MODEL 7603BL240 REQUIRES MINIMUM NEMA/TYPE 4 COMPLIANT EQUIPMENT.
6. THE FIELD INSTALLED POWER SUPPLY CORD SET NEEDS TO BE INSTALLED BY QUALIFIED PERSONNEL.
7. ALL MODELS MUST HAVE A GROUND FAULT PROTECTION DEVICE (30mA GFEPD) FOR HEAT TRACE. ELECTRICAL CURRENTS MAY BE INSUFFICIENT TO TRIP A CONVENTIONAL CIRCUIT BREAKER. ALL INSTALLATIONS MUST BE INSTALLED IN COMPLIANCE WITH LOCAL, STATE, AND/OR FEDERAL CODES.

		Haws [®]		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
				PART NUMBER 0510000769.D	
ECN NO. 5235	REVISED PER BY: MJ	MODEL(S) 7603BL / 7603BL240		REVISION 1	
DRAWN: MJ	DATE: 10/11/17	CHKD.: MJ	ELECTRICAL SCHEMATIC		
APPROVED: MJ	DATE: 05/29/18	SCALE: 1:1	DRAWING TYPE:	SIZE: A	SHEET 1 OF 1