


## NOTES:


- WHEN INSTALLING THIS UNIT, LOCAL, STATE, OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION DIMENSIONS (LOCATIONS), WASTE AND SUPPLY REQUIREMENTS OTHER THAN SHOWN.
- 2. TO COMPLY WITH ANSI Z358.1-2014 FOR EMERGENCY SHOWER EQUIPMENT:
- SHOWER SHALL BE POSITIONED SUCH THAT SHOWER HEAD IS NO LESS THAN 82" (2083mm) AND NO GREATER THAN 96" (2438mm) FROM SURFACE ON WHICH USER STANDS.
- SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 20" (508mm) AT 60" (1524mm) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED NO LESS THAN 16" (406mm) FROM NEAREST OBSTRUCTION.
- 3 INSTALL STAINLESS STEEL CABINET AS CLOSE TO DOOR JAM AS POSSIBLE.
- 4. DIMENSIONS MAY VARY BY ±1/2" (13 mm).

(NOTES CONTINUED ON SHEET 2.)

## SEE SHEET 2 FOR ALTERNATE "HANG DOWN" INSTALLATION



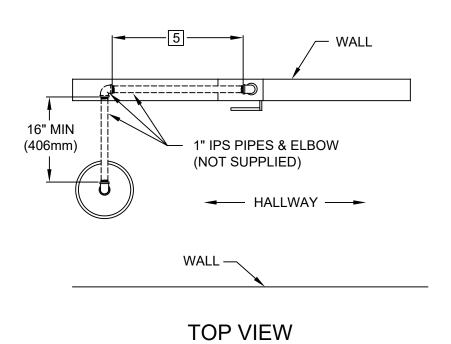

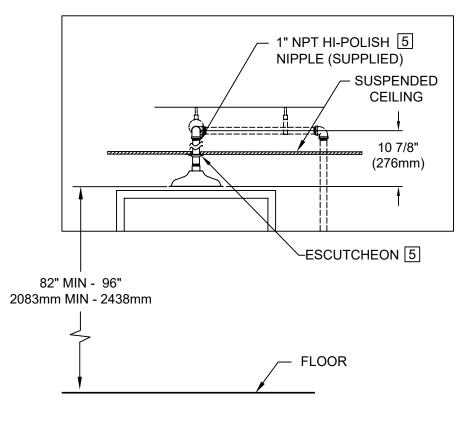

[5] ALTERNATE "HANG DOWN" INSTALLATION

NOTES: (CONTINUED FROM SHEET 1)

5 FOR ALTERNATE "HANG DOWN" INSTALLATION OF SHOWER HEAD PERFORM THE FOLLOWING STEPS: A) SWAP NIPPLE, 1" NPT X 5" LONG, FOR NIPPLE, HI-POLISH, 1" NPT X 6 1/2" LONG (SUPPIED). B) USE CEILING ESCUTCHEON FOR 1" NPT PIPE.

		F		7				9 1455 KLEPPE LANE SPARKS, NEVADA 8943' (775) 359-4712 FAX (775) 359- E-MAIL: HAWS@HAWSCO.C WEBSITE: WWW.HAWSCO.C			9-74: CON	1		
ŀ	DRAWN: DO APPROVE	ECN: DA 3	5725	FV CHK'D.: DP	MODE	L(S)		8164				PART NU 00020 REVISION	080	138.D
	FV		09/23/21		SCALE:	NA	DRAWING TYPE:		INSTALLATION	SIZE:	Α	SHEET	2 (	)F 2