



INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS

Bachweg 3, 3400 Burgdorf, Switzerland
Phone +41 (0) 34 420 60 00 Fax +41 (0) 34 420 60 01
E-mail: info@haws.ch website: www.haws.ch

No. 02080038 (1)

Model 7260B AXION (Item Number 10004428) Eye/Face Wash

NOTE TO INSTALLER: Please leave this information with the Maintenance Department.

SHOULD YOU EXPERIENCE DIFFICULTY WITH THE INSTALLATION OF THIS MODEL PLEASE CALL:

CUSTOMER SUPPORT: +41 (0) 34 420 60 00

LOCATION OF UNIT: The Model 7260B AXION Eyewash units should be installed in close proximity to potential accident areas. It should be clearly identified, free from obstructions and easy to access.

SUPPLY LINE: The minimum recommended line size is 1/2" G with 30-90 psi (2-6 ATM) flowing pressure. Where sediment or mineral content is a problem, an inlet filter is recommended.


PLUMBING CONNECTIONS: The inlet supply is female 1/2" G, the waste outlet is 1-1/4" O.D. tailpiece.

TROUBLESHOOTING	
PROBLEM	REPAIR CHECKLIST
1. No flow.	1. Check the main shut-off valve.
2. Insufficient water flow.	2. a. Verify minimum 30psi flowing supply line pressure. b. Probable clogging of flow control due to inadequate line flushing. Unscrew eye/face wash head and remove the four screws to disassemble the head. Clean flow control and reassemble head. See SP65 Installation Drawing for details. c. Remove cap located on L – Strainer using a 3/8" allen wrench to access and clean filter screen.
3. Eyewash or face wash streams do not meet desired eye level or are not balanced.	3. Possible blocked flow control, see above solution. Possible non-leveled eyewash assembly.
4. Water does not drain properly.	4. Check the main waste line of your building to see if it does handle the capacity required for the entire drainage system.



For more information about Haws products, see our website: www.haws.ch

PARTS BREAKDOWN


ITEM	DESCRIPTION	MODEL NO.	ITEM NO.
1	AXION EYE/FACE WASH HEAD	SP65	10006249
2	FLOW CONTROL	SP37.5	10001711
3	DUST COVER	SP9091	10000718
4	BOWL	SP93	10006284
5	VALVE ASSEMBLY	SP229	10006167
6	BRACKET	SP80	10000288
7	INLINE STRAINER	SP509	10006227
8	REPAIR KIT FOR SP509	VRKEWSTR	10006353
9	TAILPIECE	SP95	10003425
10	EYEWASH SIGN	SP175	10003193
11	TEST TAG	SP170	10006134
--	FOOT TREADLE (NOT SHOWN)	SP220W	10006156

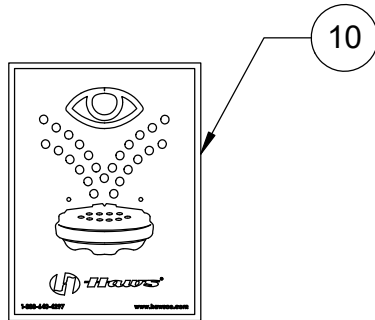





OPTIONAL -

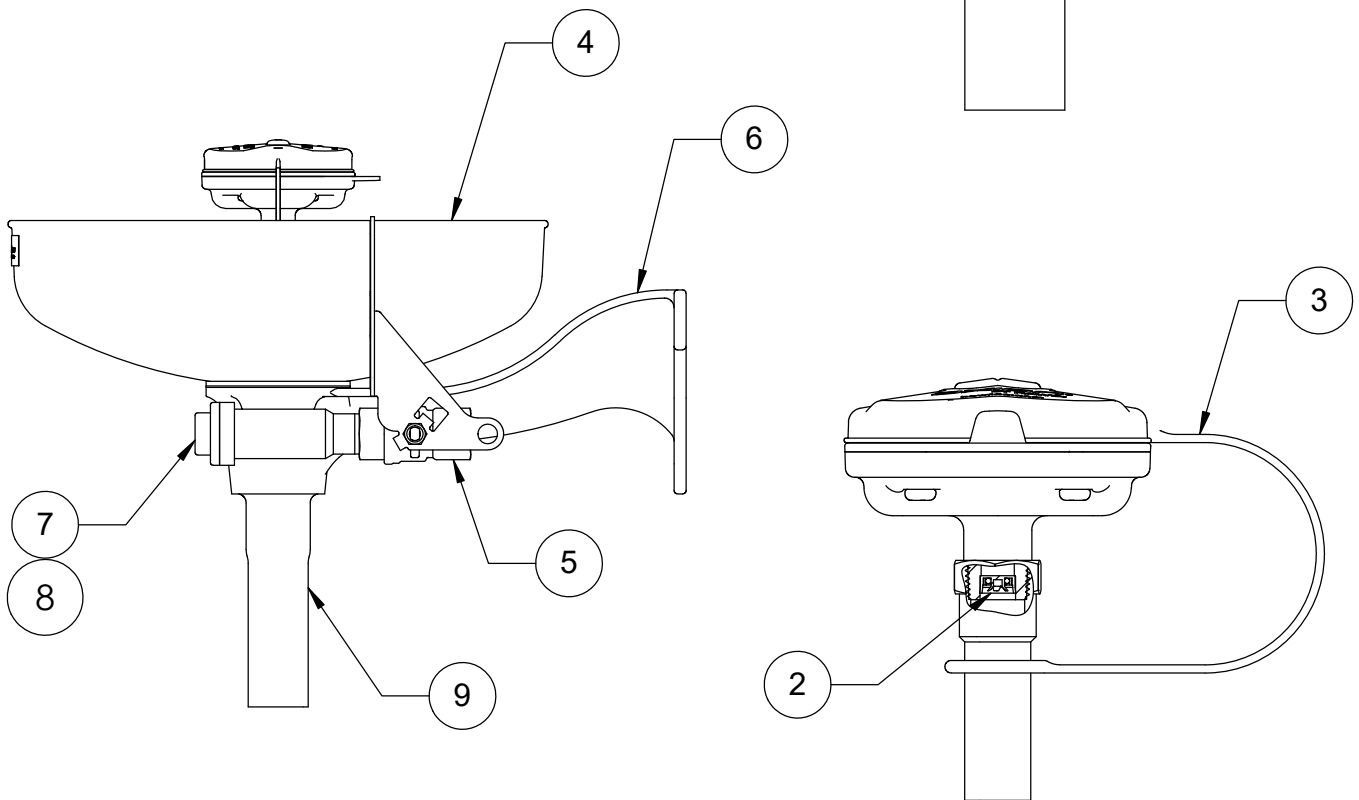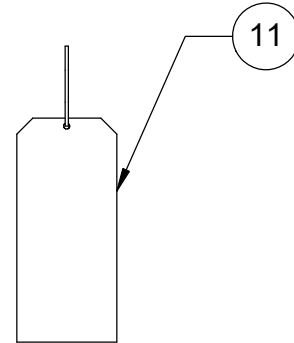

1 SP65 EYE/FACE WASH ASSEMBLY
(INCLUDES: EYE/FACE WASH HEAD, ADAPTER,
FLOW CONTROL, DUST COVER)

		HAWS AG BACHWEG 3 3400 BURGDORF SWITZERLAND T +41 (0)34 420 60 00 F +41 (0)34 420 60 01 E-MAIL: INFO@HAWS.CH WEBSITE: WWW.HAWS.CH	
		ECN: 0001 REV. ECN: BY: IR MODEL(S) DRAWN: DATE: 11/24 CHKD: IR APPROVED: DATE:	
WHEN ORDERING PARTS, PLEASE SPECIFY ITEM NUMBER		7260B AXION (10004428)	
SCALE: NA DRAWING TYPE: PARTS BREAKDOWN SIZE: A SHEET 1 OF 1		PART NUMBER: 02080038 REVISION: 1	

WALL MOUNT DETAIL

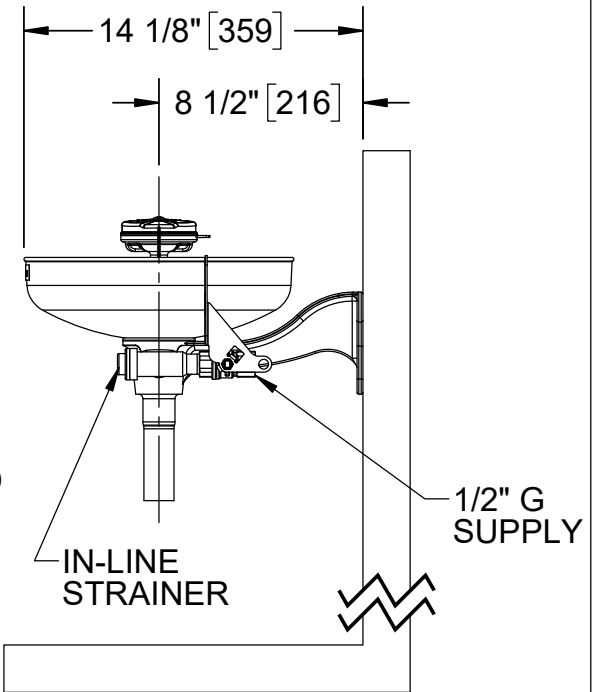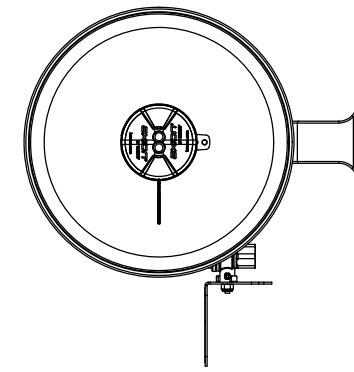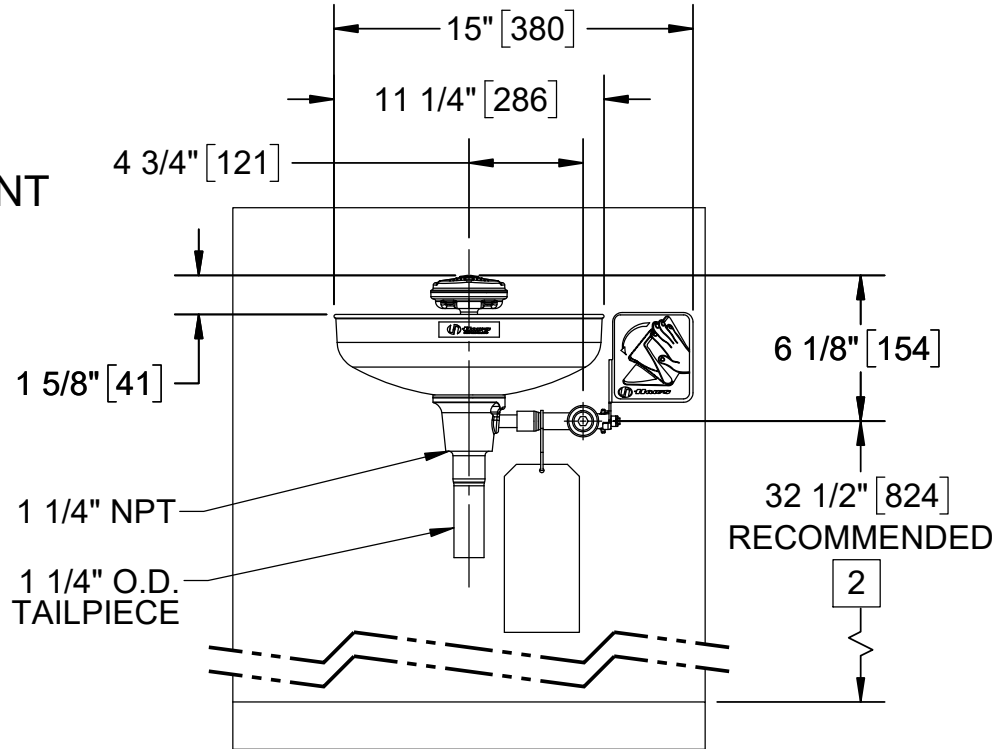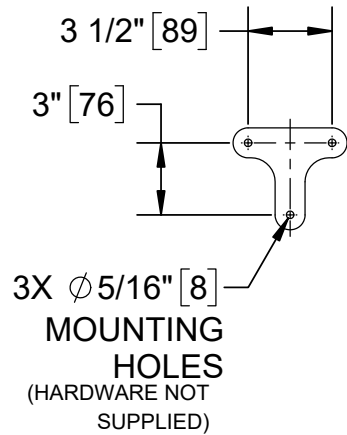

NOTES:

1. WHEN INSTALLING THIS UNIT, LOCAL CODES SHOULD BE ADHERED TO FOR INSTALLATION DIMENSIONS (LOCATIONS), WASTE AND SUPPLY REQUIREMENTS OTHER THAN SHOWN.

2. TO COMPLY WITH ANSI Z358.1-2014 FOR EMERGENCY EYEWASH OR EYE/FACE WASH: EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED SUCH THAT FLUSHING FLUID PATTERN IS NOT LESS THAN 33" (838mm) AND NO GREATER THAN 53" (1346 mm) FROM SURFACE ON WHICH USER STANDS; AND 6.0" (153mm) MINIMUM FROM WALL OR NEAREST OBSTRUCTION .

TO COMPLY WITH DIN EN 15154-2 FOR PLUMBED-IN EYEWASH: EYEWASH SHALL BE POSITIONED SUCH THAT OUTLET NOZZLES ARE NOT LESS THAN 31.5" (800mm) AND NO GREATER THAN 47.24" (1200 mm) FROM SURFACE ON WHICH USER STANDS; AND 5.9" (150mm) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.

3. DIMENSIONS MAY VARY BY ±1/2" (13 mm).

4. DIMENSIONS IN BRACKETS, IN DRAWING SPACE, ARE METRIC [mm].



HAWS AG
BACHWEG 3
3400 BURGDORF SWITZERLAND
T +41 (0)34 420 60 00 F +41 (0)34 420 60 01
E-MAIL: INFO@HAWS.CH
WEBSITE: WWW.HAWS.CH

ECN: 0001	REV. ECN:	BY: IR	MODEL(S)	PART NUMBER
DRAWN: IR	DATE:	CHKD: IR	7260B AXION (10004428)	02080038.D
APPROVED: IR	DATE: 11/12/2024	SCALE: 1:2.5	DRAWING TYPE: INSTALLATION	REVISION 1
			SIZE: A	SHEET 1 OF 1